



SAND BEDDING: FOR ALL OPEN TRENCHING, A GEO-SYNTHETIC SHEETING SHALL BE LAID PRIOR TO INSTALLATION OF THE SAND BEDDING, THAT SHALL BE IN ACCORDANCE WITH EA TS 97-1 SPECIAL BACKFILLING MATERIAL FOR CABLE INSTALLATIONS.

**TYPICAL CABLE TRENCH DETAIL**

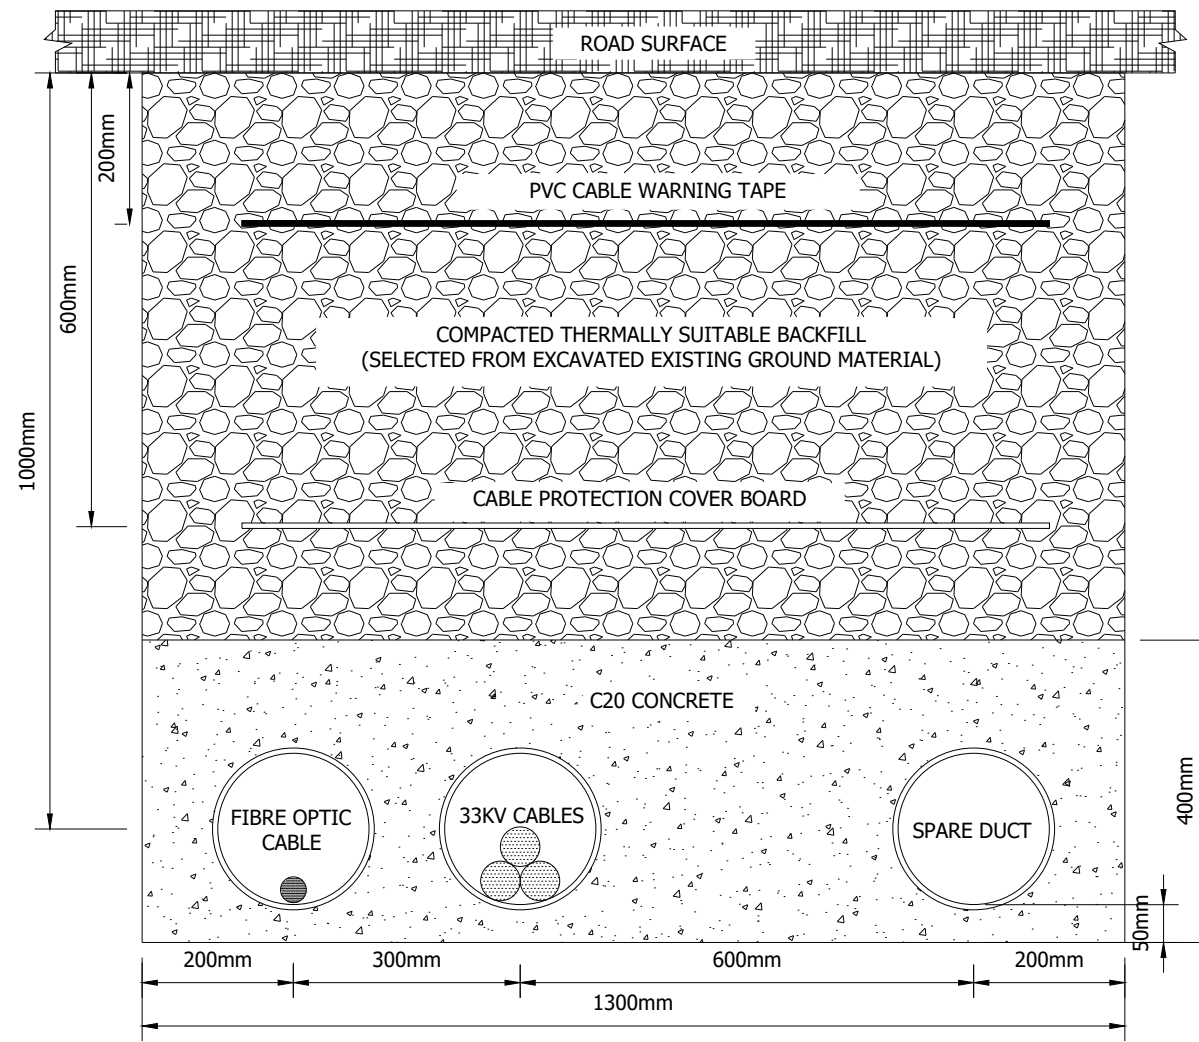

**TYPICAL CABLE TRENCH DETAIL AT ROAD CROSSING**



1:10 Scale @ A3

Produced: RC  
Reviewed: RC  
Approved: TA

Ref: 3959\_DR\_P\_0008  
Date: 15.02.23

**INDICATIVE CABLE TRENCH**  
EIA REPORT - FIG 3.8

**TORRANCE WIND FARM**  
**EXTENSION II**