



Legend

- Site Boundary
- ⊕ Proposed Turbine Location
- Turbine Hardstanding
- Access Track
- Substation Compound
- Temporary Construction Compound
- Proposed Recreational Path
- 500m Buffer of Site Infrastructure
- Noise-sensitive Receptor
- Construction Noise Assessed Receptors



Produced By: MT	Ref: 3959-REP-088
Checked By: SC	Date: 15/02/2023

**Figure 7.1**  
**Construction Noise Assessment**

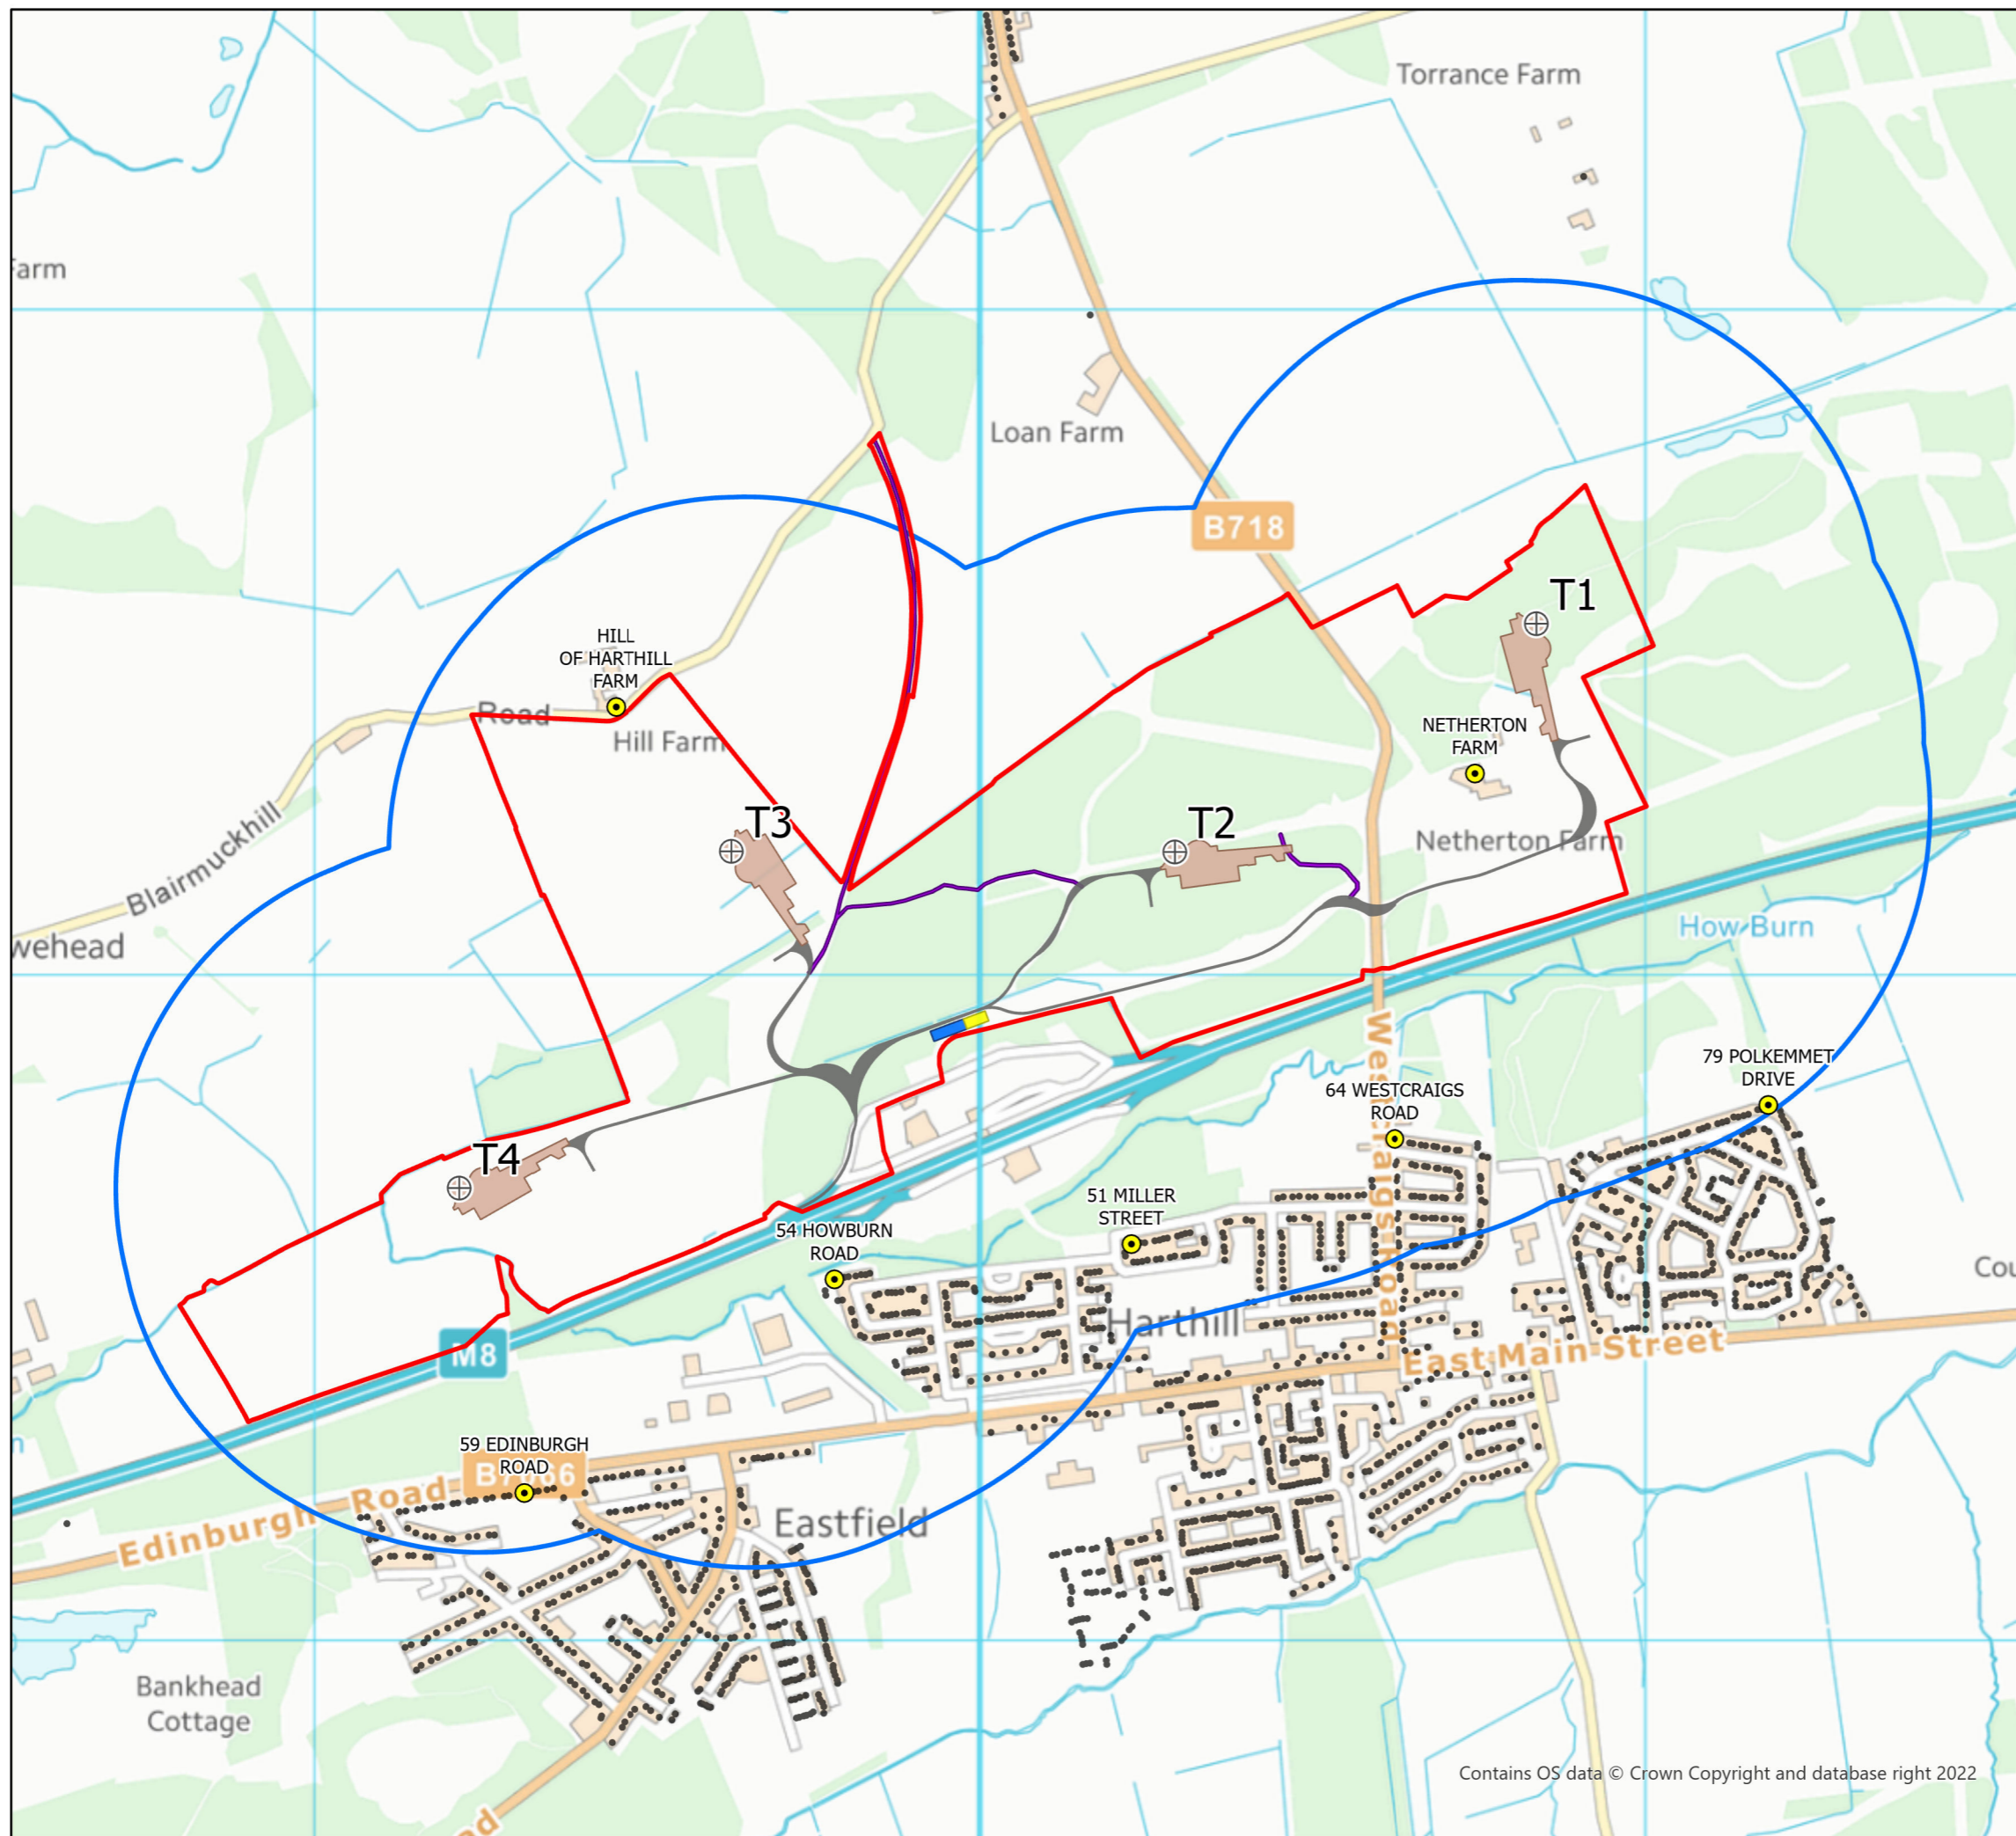

Contains OS data © Crown Copyright and database right 2022